


Response of the Fukushima Dai-ichi Nuclear Plant to the March 11, 2011 Earthquake in Japan

Dr. George Flanagan

Oak Ridge National Laboratory

Presented to the EERI/NEC
Meeting

April 12, 2012

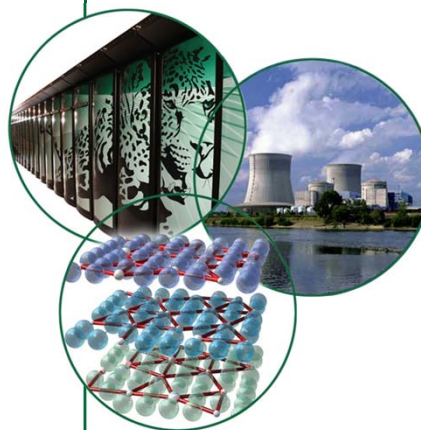

OAK RIDGE NATIONAL LABORATORY
MANAGED BY UT-BATTELLE FOR THE DEPARTMENT OF ENERGY

Presentation Outline

- Basic Reactor Physics and Boiling Water Design
- Sequence of Events
- Consequences and Mitigation
- Conclusions and Lessons Learned


Basic Reactor Physics and Boiling-Water Reactor (BWR) Design

3 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012




Fission Results in the Production of Energy, Neutrons, and Fission Fragments (Products) — Which are Highly Radioactive

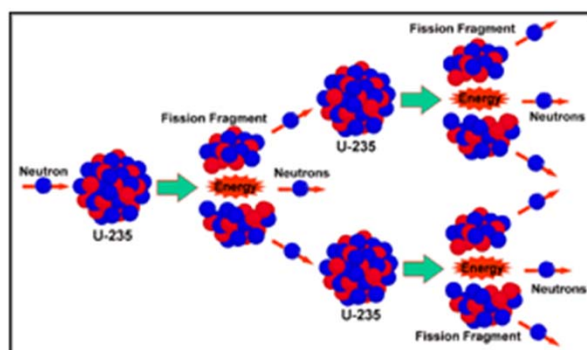

4 Managed by UT-Battelle
for the U.S. Department of Energy



After a Reactor is Shutdown — Heat is Still Generated Because of the Decay of the Radioactive Fission products(Fragments)

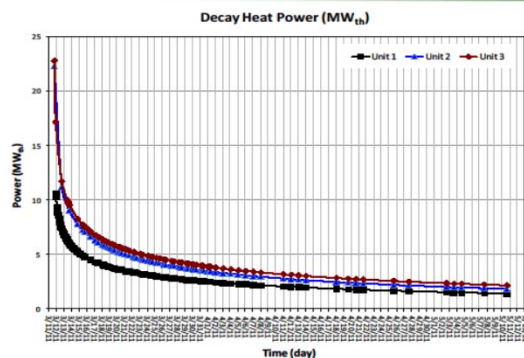


5 Managed by UT-
for the U.S. Dept.

10/10/11

Boiling-Water Reactor (BWR) Uses Nuclear Heat to Boil Water to Create Steam to Produce Electricity

Courtesy of NEXTERA
Energy

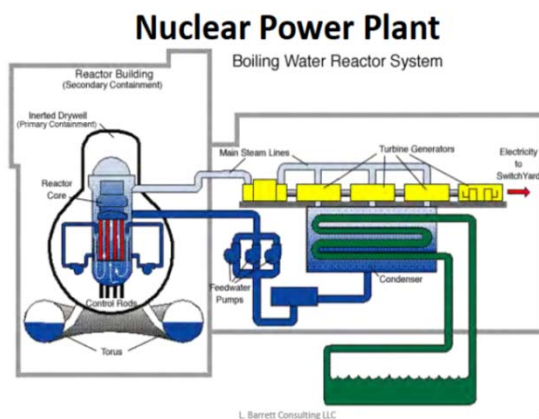


6 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012

OAK
BRIDGE
National Laboratory

Nuclear Plants are Designed With Many Barriers to Prevent Release of Radioactive Material Resulting from Fission

Nuclear Fuel Barriers & Heat Output

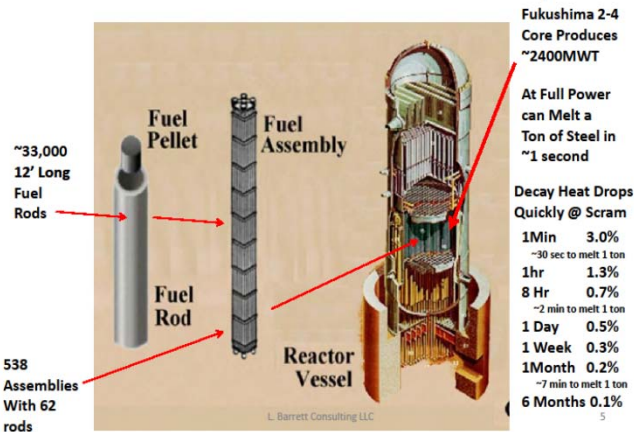


7 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Mark 1 Boiling-Water Reactor Containment Design

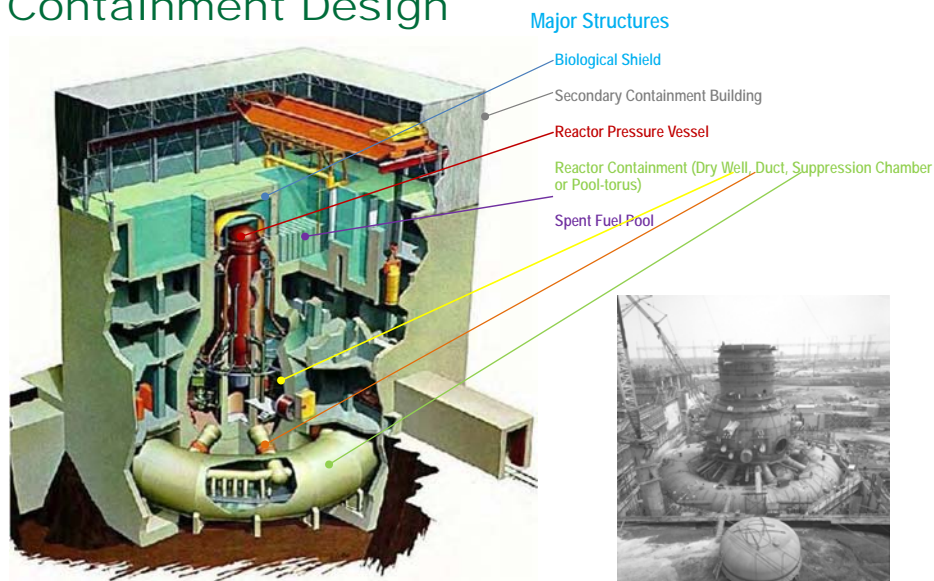


Courtesy of TVA

8 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



GE BWR Mark I Containment

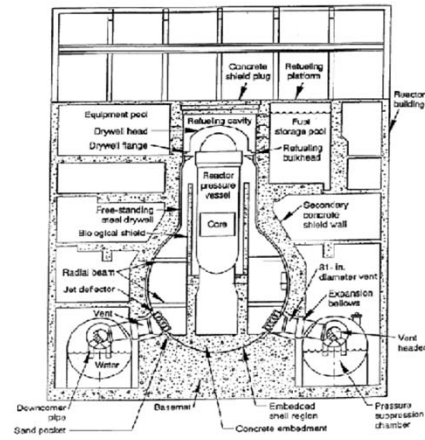

17

Briefing on Fukus

Figure 20. Mark I General Electric, GE BWR Containment.

Myung-Hyun Kim

9 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Sequence of Events


10 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



9.0 Earthquake Occurs of the Coast of Japan at 2:46 PM, March 11, 2011

3.11 Earthquake and aftershocks

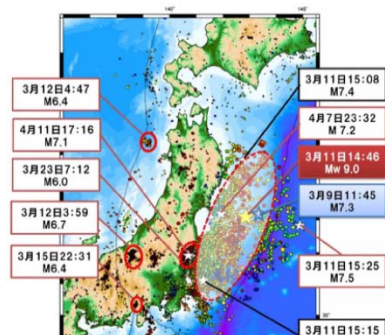

Statement by the Headquarter for Earthquake Research, 11 March 2011

The Earthquake Research Committee evaluated earthquake motion and tsunami for the individual region off-shore of Miyagi prefecture, to the east off-shore south of Sanriku along the trench, and to the south off-shore of Ibaraki prefecture, but occurrence of the earthquake that is linked to all of these regions is "out of hypothesis".

[SOURCE]

<http://www.jishin.go.jp/main/index-e.html> The 2011 off the Pacific Coast of Tohoku Earthquake

http://outreach.eri.u-tokyo.ac.jp/eqvolc/201103_tohoku/eng/#mesonet

"Earthquake Research Institute, University of Tokyo, Prof. Takashi Furumura and Project Researcher Takuto Maeda"


11 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Earthquake/Tsunami Affected Fourteen Plants on the Eastern Coast of Japan

14 NPPs along the coastal line affected by Tsunami

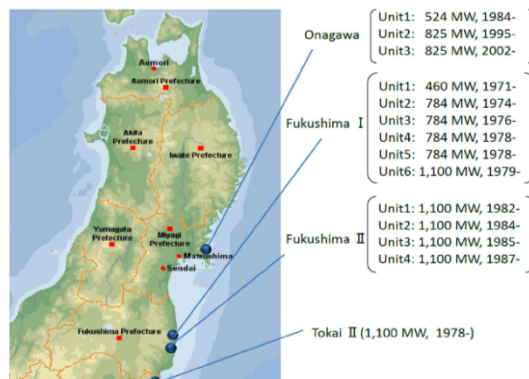

Courtesy of TEPCO

12 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Some Units of Fukushima 1 (Dai-ichi) were in Operation at the Time of Earthquake

- Units 1–3 were operating at full power
- Unit 4 was defueled (entire core stored in spent fuel pool)
- Unit 5–6 in a refueling outage

13 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Nuclear Plant Safety Features Perform as Designed Until the Tsunami Hits

3.11 Tsunami

1F1-3 Plant response immediately after the earthquake

- 14.46 Earthquake followed by Reactor SCRAM,
LOOP, EDGs start, IC/RCIC in operation
- 15.38-41 Tsunami followed by complete (AC/DC) blackout
and (mostly) isolation from the Ultimate Heat Sink



http://outreach.eri.u-tokyo.ac.jp/en/evlc/201103_tohoku/ena/#mesonet

"Earthquake Research Institute, University of Tokyo, Prof. Takashi Furumura and Project Researcher Takuto Maeda"

5

14 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Horizontal E-W Acceleration Exceeded the Seismic Design on Units 2,3, and 5

Seismic Observed Data

Comparison between Basic Earthquake Ground Motion and the record of intensity

Observation Point (The lowest basement of reactor buildings)		Observed data (*Interim)			Maximum Response Acceleration against Basic Earthquake Ground Motion (Gal)		
		Maximum Response Acceleration (gal)					
		Horizontal (N-S)	Horizontal (E-W)	Vertical	Horizontal (N-S)	Horizontal (E-W)	Vertical
Fukushima Daiichi	Unit 1	460 ^{#2}	447 ^{#2}	258 ^{#2}	487	489	412
	Unit 2	348 ^{#2}	550 ^{#2}	302 ^{#2}	441	438	420
	Unit 3	322 ^{#2}	507 ^{#2}	231 ^{#2}	449	441	429
	Unit 4	281 ^{#2}	319 ^{#2}	200 ^{#2}	447	445	422
	Unit 5	311 ^{#2}	548 ^{#2}	256 ^{#2}	452	452	427
	Unit 6	298 ^{#2}	444 ^{#2}	244	445	448	415
Fukushima Daini	Unit 1	254	230 ^{#2}	305	434	434	512
	Unit 2	243	196 ^{#2}	232 ^{#2}	428	429	504
	Unit 3	277 ^{#2}	216 ^{#2}	208 ^{#2}	428	430	504
	Unit 4	210 ^{#2}	205 ^{#2}	288 ^{#2}	415	415	504

*1: The data above is interim and is subject to change.

*2: The recording time was about 130-150 seconds

All Rights Reserved ©2011 The Tokyo Electric Power Company, Inc.

10


15 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Damage at Switchyard at Fukushima Dai-ichi NPS

[275kV air blast breaker: completely destroyed]

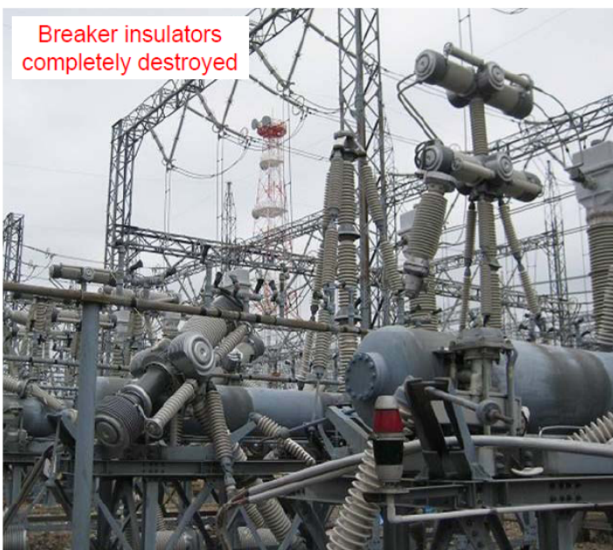

15 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



2. Outline of Fukushima Dai-ichi NPS



Courtesy of TEPCO

7

17 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012




Tsunami Waves (47 feet) Hit Fukushima 1 Plant About 1 Hour After the Earthquake




18 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



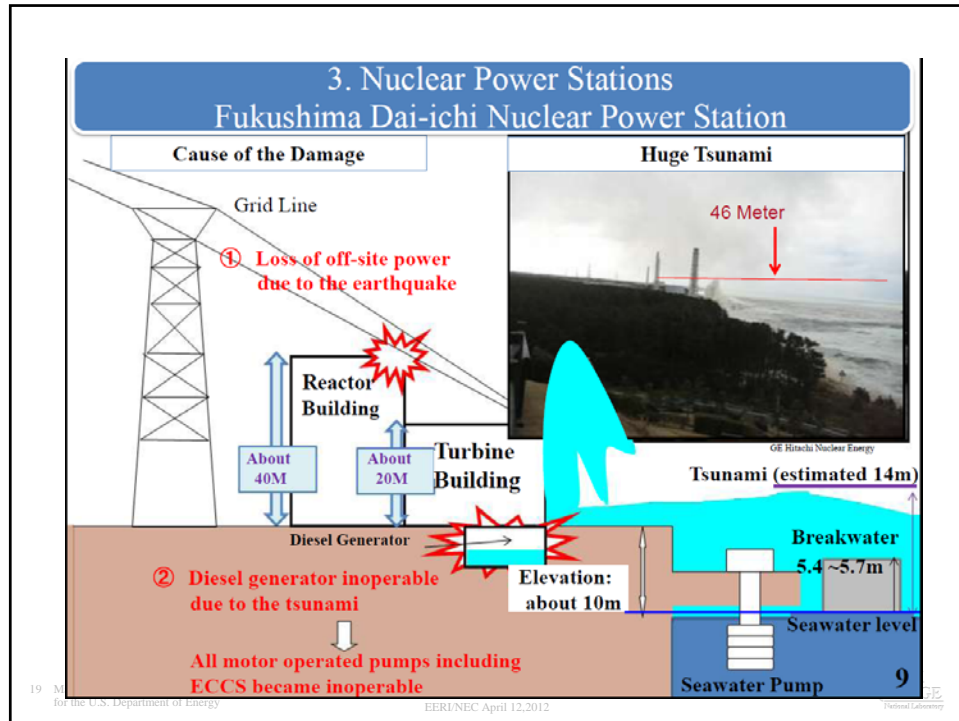

Nearly all the Daiichi Site Was Flooded

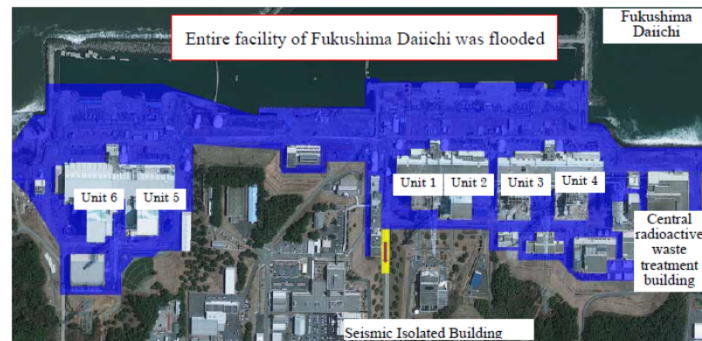

Only One Diesel Generator Survived at Dai-ichi

[Power supply at Fukushima Daiichi: Immediately after the tsunami]

Fukushima Daiichi Units 1-4

No surviving power source

Okuma Line 1L, 2L

Receiving circuit breaker damaged in earthquake

Okuma Line 3L


Renovation work in progress

Okuma Line 4L
Cause of shutdown is currently being investigated

Fukushima Daiichi Units 5-6

Only power source to survive was DG6B

Yonomori Line 1L, 2L
Partial collapse of the iron tower

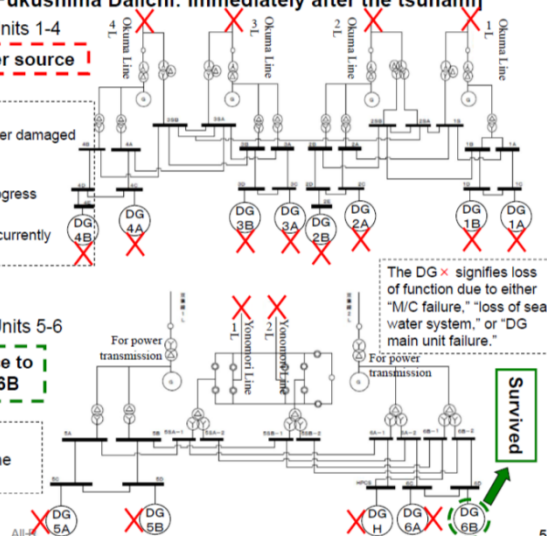

21 M
for the U.S. Department of Energy

EERI/NEC April 12, 2012


51

OAK
RIDGE
National Laboratory

Earthquake Resulted in Loss of Offsite Power/Tsunami Resulted in Loss of All Onsite AC Power (except unit 6)

- Emergency Plant systems work as designed after earthquake
- Diesel generators were submerged by tsunami (unit 1 Batteries were submerged)
- Backup batteries were depleted after 8-10 hours

**Battery Power Control of Steam-Driven Reactor
Core Isolation Cooling System In Units 2 & 3 (Unit 1
Had Isolation Condenser which Boiled Dry)**

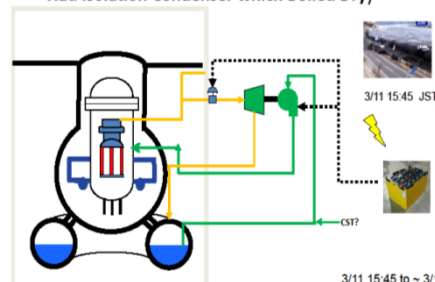

22 Managed by UT-Battelle
for the U.S. Department of Energy

Slide 22


L. Barrett Consulting LLC

3/11 15:45 to ~ 3/11
24:00 JST

OAK
RIDGE
National Laboratory

Loss of Battery Power Results in Loss of Ability to Remove Decay Heat From the Core

Battery Power Exhausted

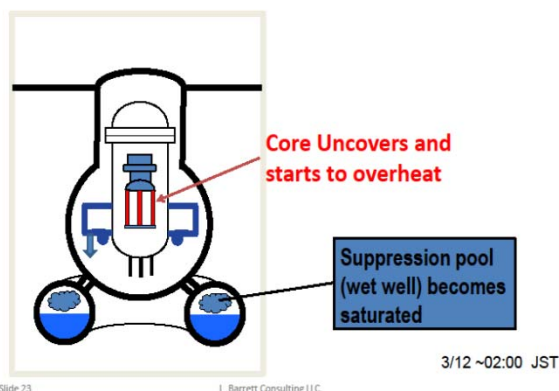

23 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Loss of All AC/DC Power Prevented Use of Cooling and Venting Systems

1F1 Equipment status after the tsunami (equipment used for water injection to the reactor and PCV venting)

Equipment name	Status	Damage status	Applied operations	Remarks (2F1)
Water injection equipment	×	Loss of power (oil pump)	—	○ Timely water injection is possible using the MUWC
	×	Water injection not possible due to isolation signal	—	
	×	Power and sea water system loss	—	
	×	Power and sea water system loss	—	
	×	Loss of power, motor water damage	Fire engine used	
	×	D/D FP* startup not possible		
PCV Venting equipment	×	DC power loss/low air pressure	Temporary battery Temporary air compressor	○ Valves can be operated when necessary
	×	DC power loss/low air pressure		
	×	DC power loss/low air pressure		
	×	DC power loss/low air pressure		
	×	Power loss	Manual operation	
Applied operations were required as the above-mentioned equipment could not immediately be used after the tsunami.				

24 Managed by UT-Battelle
for the U.S. Department of Energy


EERI/NEC April 12, 2012




Possible Sequence Leading to Core Damage and Release of Hydrogen




Core Damage Sequence



Core Uncovered



Fuel Overheating




Fuel melting - Core Damaged




Core Damaged but retained in vessel



Core Melt-through
Some portions of core melt into lower RPV head



Containment pressurizes.
Leakage possible at drywell head



Releases of hydrogen into secondary containment

11

25 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Hydrogen Produced by Zr Clad Interacting with the Steam


Fukushima: Reactor Vessel-Primary-Secondary Containment Sequence

Primary Coolant System




Core Over Heat
-Clad Burst ~900C
-Clad Oxidize ~1200C
-H₂ Release
-Partial Melt~1800C-2700C
-Primary Coolant System Overpressure

Primary Containment



Vent from Primary Coolant Sys to Primary Containment- H₂, Steam, & Fission Products (Xe, Kr, I, Cs etc)
L. Barrett Consulting LLC

Secondary Containment



No Primary Containment Cooling therefore Primary Containment Overpressure- Vent to Secondary Containment

27

26 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Overpressure of the Containment Resulted in Opening Leakage Pathways for Some Steam and Hydrogen to Enter the Reactor Building—Bypassing the Vent Lines

- Resulted in explosive mixture of hydrogen gas to accumulate in the reactor buildings of Units 1 and 3
- A panel was removed from Unit 2 to vent the building
- A fire and explosion occurred in Unit 4 (reactor was defueled)
 - Thought to be a result of uncovering of the spent fuel
 - Appears this was not the case
 - Cause of Unit 4 explosion is now thought to be from Hydrogen generated in unit three being carried into unit 4 through a shared vent line.

27 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Result Was An Explosion in Units 1 and 3 Destroying Parts of the Reactor Buildings



Unit 1

Unit 3

14

Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Aftermath Destroyed the Secondary Containment, Some Vent Lines - Allowed Uncontrolled Release of Radioactivity to the Atmosphere, to the Site, and to Areas Surrounding the Site—Resulting in An Evacuation (20 km)




29 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012

OAK
RIDGE
National Laboratory

Presumption of reactor core statement (Unit 1)

- Almost no fuel was left at the original position, and completely moved downward after it melted.
- The moved fuel likely damaged PCV and assumed that most of it had dropped to the bottom. (Details for dropped fuel is unknown)
- Dropped fuel is assumed to have caused core concrete reaction.
- Therefore, it is evaluated that all the moved fuel is expected to be cooled directly by water injection. It is also evaluated that the core concrete reaction has been stopped.

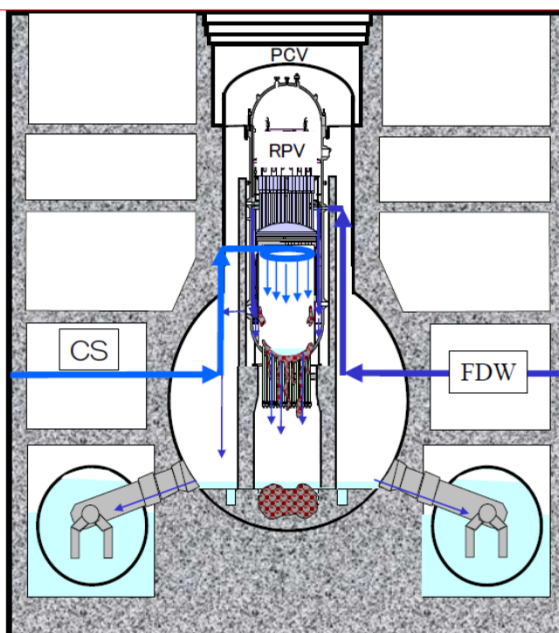

TOKYO ELECTRIC POWER COMPANY

©2012 The Tokyo Electric Power Company, INC. All Rights Reserved.


5

Presumption of reactor core statement (Unit 2 and 3)

There is a range in the evaluation result from “damaged fuel dropped to part of the bottom of PCV” to “Almost all the fuel is left inside RPV”.

If the part of damaged fuel were to have dropped to the bottom of PCV, it can be assumed that core concrete reaction was caused.

Therefore, it is evaluated that all the moved fuel is expected to be cooled directly by water injection. It is also evaluated that the core concrete reaction has been stopped.

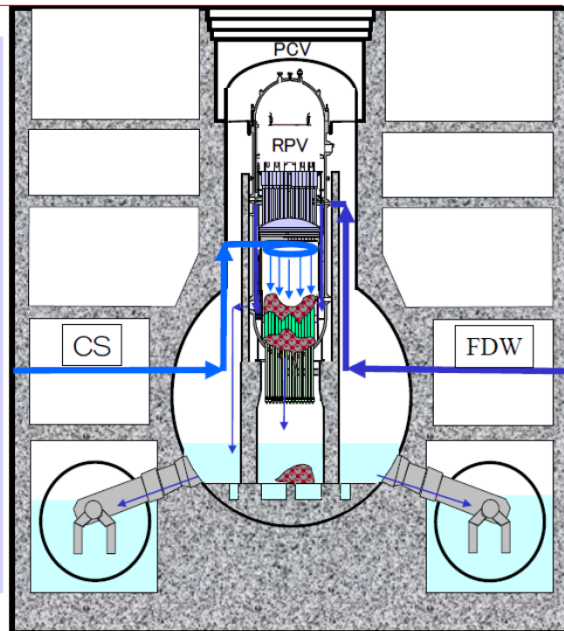

TOKYO ELECTRIC POWER COMPANY

©2012 The Tokyo Electric Power Company, INC. All Rights Reserved.

55

Consequences and Mitigation

Most of the Time Following the Accident the Wind was Blowing Towards the Sea, However, There Were Times When the Winds Blew Towards the Northwest


- Resulted in a Plume Carrying Radiation to Drift Inland
 - Mandatory Evacuation Ordered for 20 km around the plant
 - Area between 20-30km asked to shelter in place and later advised to evacuate
 - Some areas in path of plume affected beyond 30km
 - Over 70,000 inhabitants affected by evacuation

33 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Estimated Dose Is About 10 Times
Average Background (240mrem)

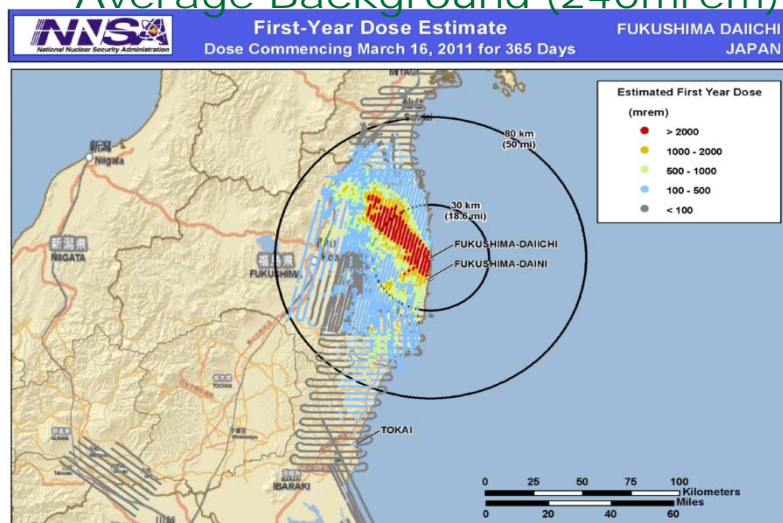

34 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



With the Successful Evacuation There Was No Significant Radiation Dose to the General Public

- Currently there are no acute radiation effects (even to workers onsite)
- Estimated cancer increase is expected to be below statistical measurement threshold
- Economic impacts enormous
 - Evacuees only allowed limited access within 30 km radius in March 2012
 - some limited access allowed to some areas within 20 km radius in early April 2012
 - Loss of Productivity (manufacturing, agricultural, fishing)
 - Decontamination Activities have begun (estimates in 10 -250 billion of dollars)
 - Radioactive waste volumes are very large and pose a problem finding appropriate disposal sites in a country with limited land mass

35 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Reactor Cores Are Being Cooled and Are Stabilized

- All reactors declared to be in cold shutdown in December 2011
 - Temperatures inside the reactors are below 100 °C
 - Cooling water leaking out of reactors is collected
 - Treated to remove radioactive materials
 - Recirculated back into the reactor
 - Radioactive water accumulated on site immediately following accident is being collected and treated as well
 - Water has been prevented from entering the ocean by use of dikes and dams
 - Decontamination of areas surrounding the reactors (on site) is ongoing- surfaces have been treated to prevent dust

36 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Cover Has Been Installed Around Unit 1 Debris Is Being Removed Before Covering Units 3 and 4




37 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Mid-to-Long-Term Roadmap towards the Decommissioning of Fukushima Nuclear Power Units 1-4

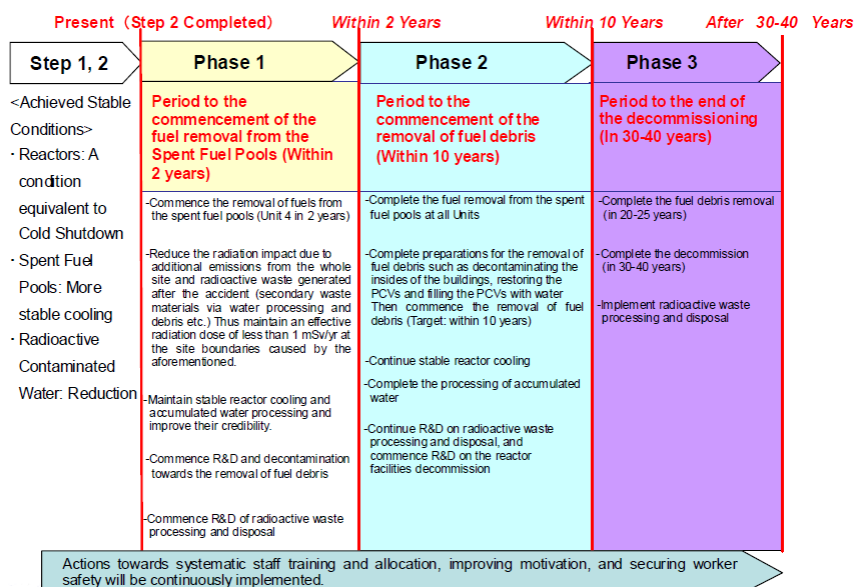

for the U.S. Department of Energy

EERI/NEC April 12, 2012

Oak Ridge National Laboratory

Social/Political Impacts in Japan and World Wide

- Resignation of Japan's Prime Minister
- Reorganization of Japanese Nuclear Regulatory Structure
- Lack of Confidence in TEPCO and the government
- Shutdown of 50+ reactors in Japan (electricity shortage predicted this summer)
- Germany, Switzerland will shutdown their existing plant and Italy has chosen not to restart their nuclear program
- US NRC just issued orders to nuclear plant owners to reexamine all existing nuclear reactors regarding seismic design, AC power sources, and venting
- Some delay of new reactor builds worldwide

39 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012



Conclusions and Lessons Learned

- External events may pose the greatest threat to nuclear plants
 - Multiple system failures can lead to significant plant damage
 - Loss of infrastructure (roads, bridges, water, power) prevented assistance
- Planning/training is essential to prevent injury and death (emergency planning, severe accident plans)
- Communication during and following an event is crucial
 - Significant delays in transmission of information between onsite and centralized locations probably contributed to the event
 - Instrumentation used to transmit plant status was lost
- Public relations during an event is very important
 - Information was difficult to obtain both within Japan and clearly in other countries
 - Contradictions led to lack of trust by the public and media
 - Lack of information prevented early assistance from outside sources

40 Managed by UT-Battelle
for the U.S. Department of Energy

EERI/NEC April 12, 2012

